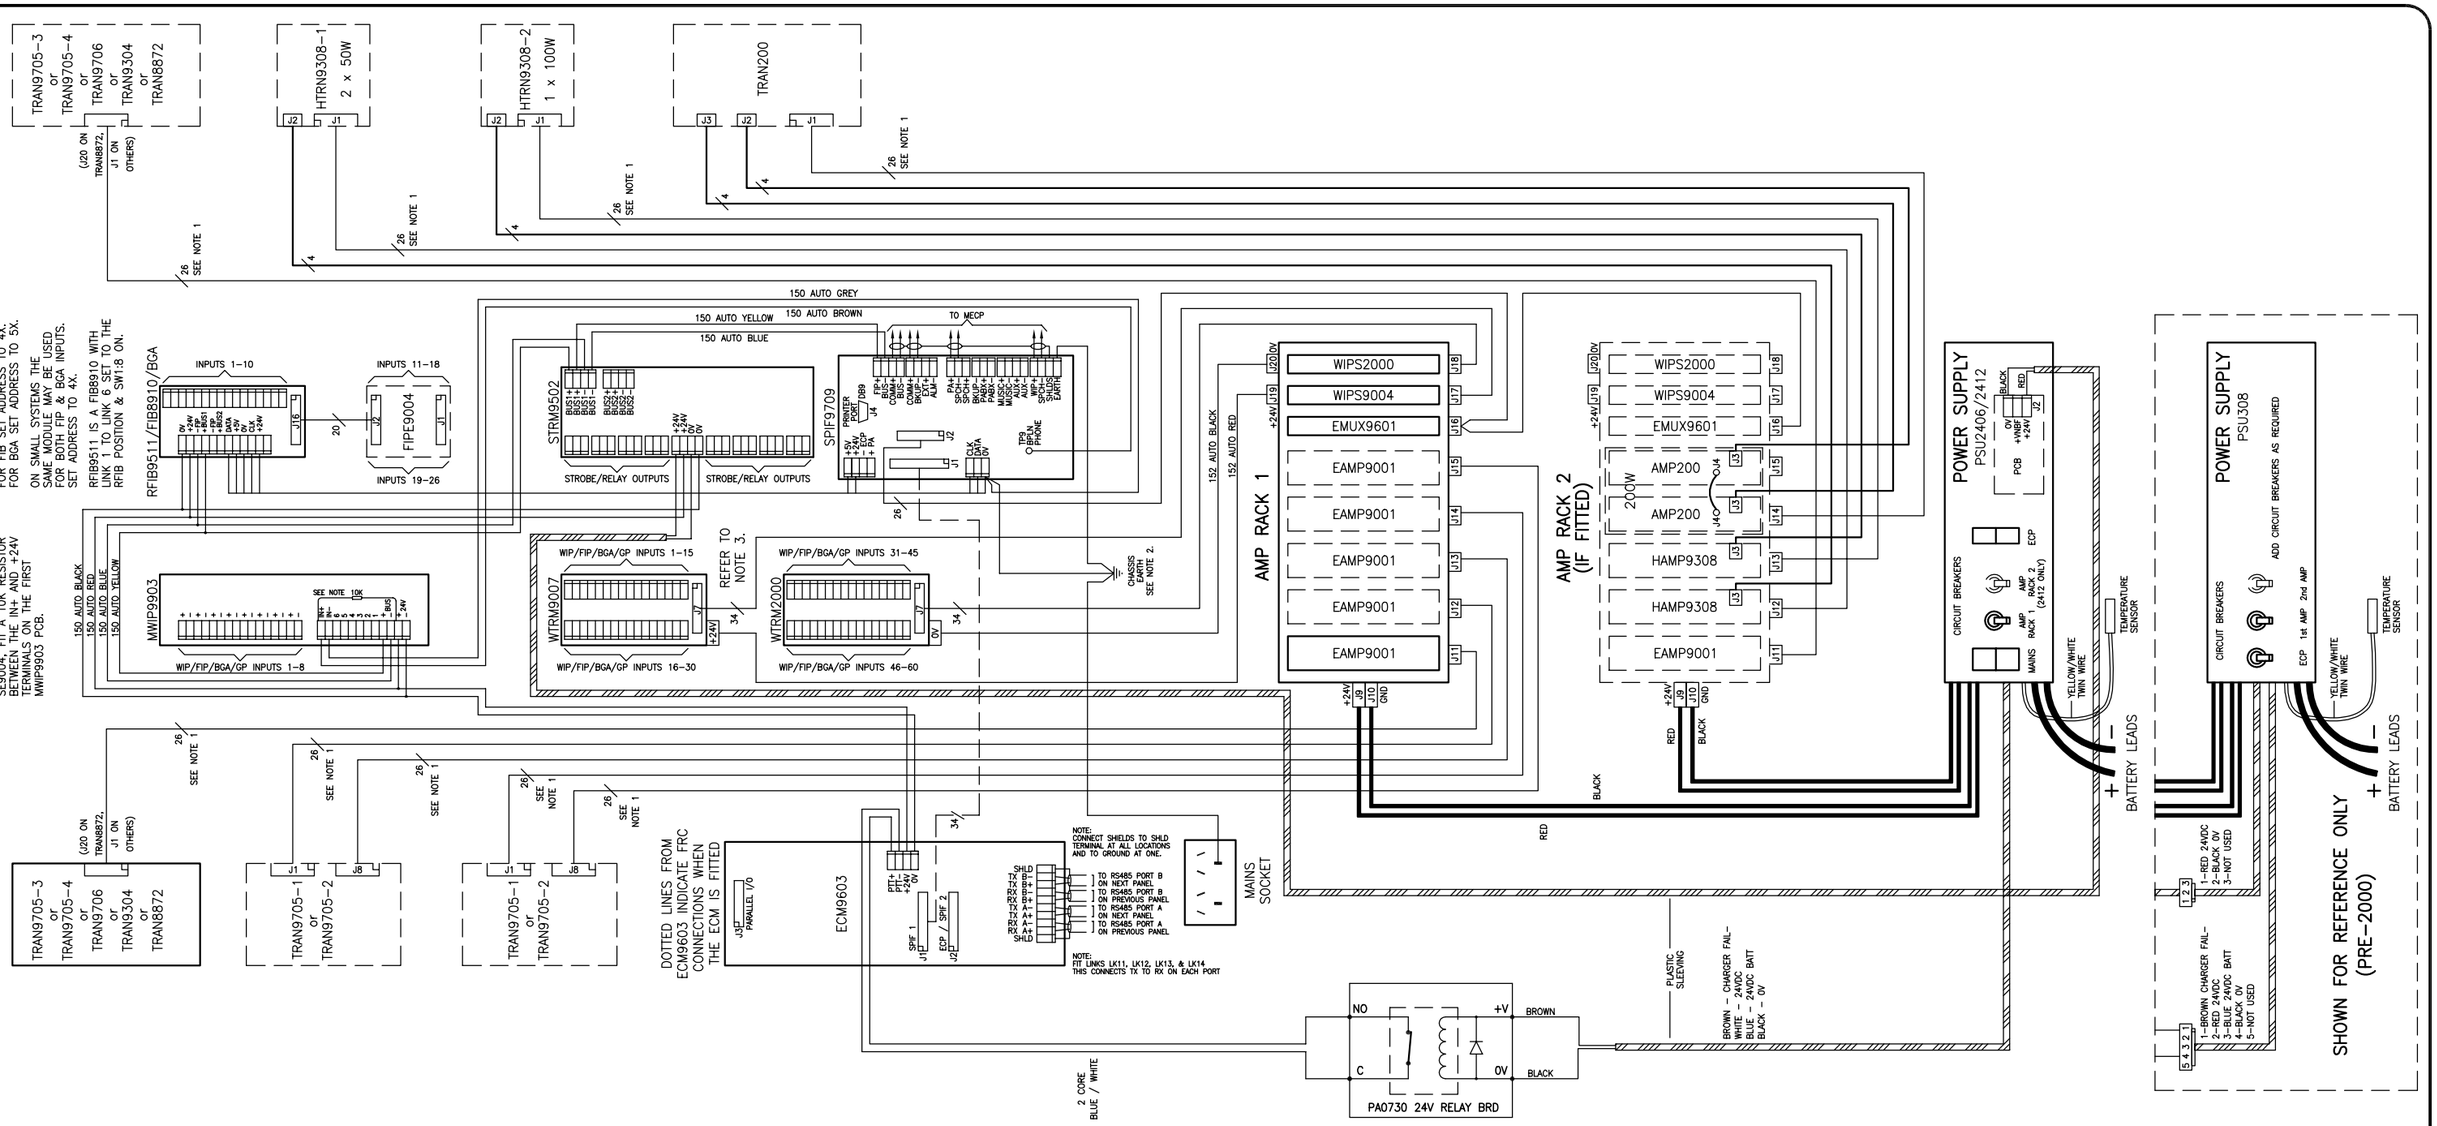

NOTES:

1. ALL FRCs BETWEEN TRANSFORMER MODULES AND THE BACKPLANE OF THE AMPLIFIER RACK ARE "TWISTED" AS SHOWN BELOW

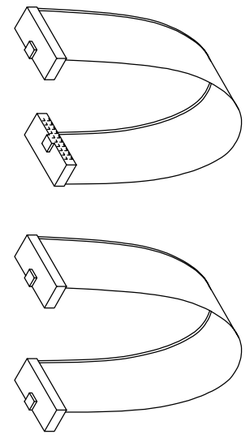

2. CHASSIS EARTH:– CONNECT TO GEAR PLATE IF FITTED, OTHERWISE DIRECTLY TO CABINET, USING 1.00 mm2 GREEN/YELLOW CABLE.
3. WTRM9007 MUST BE USED WITH WIPS9004. WTRM2000 MUST BE USED WITH WIPS2000.

C.A.D

3rd ANGLE

UNLESS OTHERWISE STATED: ALL DIMENSIONS IN MILLIMETRES. DO NOT SCALE. TOLERANCES ARE TO BE: 1 DECIMAL PLACE ±0.5, 2 DECIMAL PLACES ±0.3, 3 DECIMAL PLACES ±0.1

CONFIDENTIAL: THIS DOCUMENT MUST NOT BE COPIED NOR THE CONTENTS PASSED ON TO ANY THIRD PARTY WITHOUT THE CONSENT OF THE COMPANY.

ISS/REV	AMENDMENTS	ECO	DRN	CHKD	AUTH	APVD	DATE
C	SPIF9709 WAS SPIF9506	2714	GEL	LM	TH	DSP	18-11-97
D	RFIB9511 WAS PA0831/PA0631 NOW FIB8910 PA0851/PA0651 WITH LK1-6 CHANGED	2928	LM	GEL	TWH	DSP	28-5-99
E	PSU2406/2412, AMP/TRAN200 & MWIP9903 ADDED. EMUX9601 WAS EMUX9002.	3055					
	MAINS SOCKET & EARTHING DETAILS ADDED.	3060	GEL	KJS	TH	DSP	18-2-00
F	NOTE RE FITTING OF 10K RESISTOR TO MWIP9903 MODULE ADDED	3075	LM	GEL	TH	DSP	4-5-00
G	ECM9603 MODULE ADDED	EC727	LM	GEL	TWH	DSP	26-6-00
H	WTRM2000 & WIPS2000 ADDED. NOTE 3 ADDED.	3170	GEL				6-7-01

QE90
GENERALISED REMOTE RACK WIRING DIAGRAM

VIGILANT
FIRE & EVACUATION SYSTEMS
211 MACES ROAD, CHRISTCHURCH 8006, NZ
P.O. BOX 19-545, CHRISTCHURCH 8030, NZ
PH: +64 3 389-5096 FAX: +64 3 389-5938

SIZE	DRAWING NUMBER	SHEET NUMBER	ISS/REV	PART NUMBER
	699–198	1 of 1	H	QEXXXX